

# TB7200 Series Communicating Zone Thermostats

## SPECIFICATION DATA



TB7200 Series Thermostat



TB7200 Series Thermostat with Occupancy Sensor

## APPLICATION

The TB7200 Series PI thermostat family is specifically designed for zoning applications. The TB7200 Series are communicating thermostats with models available in BACnet® MS/TP and ZigBee® wireless mesh protocols and can be easily integrated into a WEBs-AX building automation system based on the Niagara<sup>AX</sup>® platform.

Typical applications include local hydronic reheat valve control and pressure dependent VAV with or without local reheat. Accurate temperature control is achieved due to the product's PI proportional control algorithm, which virtually eliminates temperature offset associated with traditional, differential-based thermostats. Models are available for 3 point floating and analog 0 to 10 Vdc control. In addition remote room sensing is available.

Thermostats equipped with an occupancy sensor cover provide advanced active occupancy logic, which will automatically switch occupancy levels from Occupied to Stand-By and Unoccupied as required by local activity being

present or not. This advanced occupancy functionality provides advantageous energy savings during occupied hours without sacrificing occupant comfort. All thermostats are PIR ready and can be ordered with or without Honeywell occupancy sensor. The occupancy sensor cover is available to order separately if a PIR is needed at a later time.

## FEATURES

- Available in BACnet MS/TP and ZigBee wireless protocols
- Backlit LCD display with dedicated function menu keys for simple operation
- Fully integrated advanced occupancy functionality with a PIR cover provides energy savings opportunity on select models; all other models are PIR ready and can have an optional occupancy sensor cover added at any time
- Pre-configured sequences of operation means one model meets more application needs
- Password protection to minimize parameter tampering
- Four levels of keypad lockout to limit access to change user parameters such as setpoints, system mode, etc.
- Available in 24 Vac on/off, floating or 0-10 Vdc analog control to meet advanced applications requirements
- Three configurable inputs for monitoring and advanced functions
- SPST auxiliary output that can be used for lighting or reheat
- All wiring connections are made to removable terminal blocks simplifying installation

## More Information

To learn about additional products in this family visit <http://customer.honeywell.com>.

- TB7600 Series Communicating RTU/Heat Pump Thermostats (Form No. 63-2706)
- TB7300 Series Communicating Fan Coil Unit Thermostats Specification Data (Form No. 63-2709)
- Sensors Product Overview Brochure (Form No. 63-9285)


Bacnet is a registered trademark of ASHRAE, Inc. and has received approval or has pending registration with UL and CSA. Standardized product requirements for the BACnet standard can be found at [www.bacnet.org](http://www.bacnet.org). BACnet is a trademark of the Bacnet International Organization.


63-2708-04

## TB7200 Series Models

Product Number	Description	Outputs	Occupancy Sensor <sup>1</sup>
<b>BACnet Models</b>			
TB7200C5014B	Modulating with Reheat	2 floating or on/off + 1 Aux	Ready
TB7200C5514B	Modulating with Reheat	2 floating or on/off + 1 Aux	Yes
TB7200F5014B	Modulating with Reheat	2 0-10Vdc + 1 Aux	Ready
TB7200F5514B	Modulating with Reheat	2 0-10Vdc + 1 Aux	Yes
<b>Wireless Models</b>			
TB7200C5014W	Modulating with Reheat	2 floating or on/off + 1 Aux	Ready
TB7200C5514W	Modulating with Reheat	2 floating or on/off + 1 Aux	Yes
TB7200F5014W	Modulating with Reheat	2 0-10Vdc + 1 Aux	Ready
TB7200F5514W	Modulating with Reheat	2 0-10Vdc + 1 Aux	Yes
<b>Accessories</b>			
TB-PIR-ZN	Zone Occupancy Sensor Cover		
TB-RA-1014	Wireless Remote Antenna Base		
TB-RP5000W	Wireless Repeater for TB7XXX Series Wireless Thermostats		
TBST-5014W	ZigBee Wireless Survey Toolkit		
TB-VWG-APP-1014	TB7XXX Series Wireless Communication Card		
TB-WALL-1014	Room Sensor 10K NTC Type 2		
TB-WALLOVR-1014	Room Sensor with Override 10K NTC Type 2		

<sup>1</sup>Thermostats ordered without an occupancy sensor cover can be retrofitted with the cover at a later time if required

## Theory of Operation

The TB7200 uses a proprietary adaptive logic algorithm to control the space temperature. This algorithm controls the heating / air conditioning system to minimize overshoot while still providing comfort. It provides exceptional accuracy due to its unique PI time proportioning control algorithm, which virtually eliminates temperature offset associated with traditional, differential-based on/off thermostats.

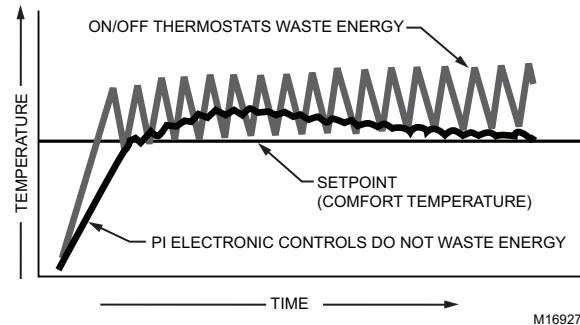


Fig. 1. On/Off mechanical control vs. PI electronic control.

# SPECIFICATIONS

**Network Protocol:** Models available in BACnet MS/TP or Zig-Bee wireless mesh

**WEBs-AX Controllers:** Compatible with WEB-2xx, WEB-6xx, and WEB-7xx

**Platform:**

WEB-2xx and WEB-6xx - WEBStation-AX 3.0 or later  
WEB-7xx - WEBStation-AX 3.5 or later

**Thermostats Per Controller**

**BACnet:** 126 thermostats (BACnet allows 128 but 1 node is used by the controller, and when more than 64 devices are on the network a repeater is required so 1 node used by the repeater).

**Wireless:** WEB-2xx: 30  
WEB-6xx & WEB-7xx: 50

**Thermostat power requirements:** 19-30 Vac 50 or 60 Hz; 2 VA Class 2

**Operating conditions:**

32 F to 122 F (0 C to 50 C)  
0% to 95% R.H. non-condensing

**Storage conditions:**

-22 F to 122 F (-30 C to 50 C)  
0% to 95% R.H. non-condensing

**Temperature sensor:** 10 K NTC thermistor on board

**Temperate sensor resolution:**  $\pm 0.2$  F ( $\pm 0.1$  C)

**Temperature control accuracy:**  $\pm 0.9$  F ( $\pm 0.5$  C) @ 70 F (21 C) typical calibrated

**Remote Sensor Input:** 10K NTC

**Occ. Stand-By and Unocc cooling setpoint range:** 54 to 100 F (12.0 to 37.5 C)

**Occ. Stand-By and Unocc heating setpoint range:** 40 F to 90 F (4.5 C to 32 C)

**Room and outdoor air temperature display range** -40 F to 122 F (-40 C to 50 C)

**Proportional band for room temperature control:** Cooling and Heating: 3.2 F (1.8 C)

**Binary inputs:** Dry contact across terminal BI1, BI2 and UI3 to Scom

**Contact output rating:**

Triac output: 30 Vac, 1 Amp. Maximum, 3 Amp in-rush  
Analog: 0 to 10 Vdc into 2K $\Omega$  resistance min.

**Wire gauge** 18 gauge maximum, 22 gauge recommended

**Dimensions:** see Fig. 2.

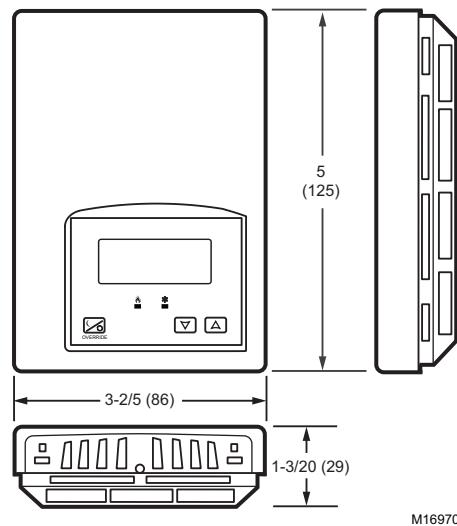


Fig. 2. Thermostat dimensions in inches (mm).

**Approximate shipping weight:** 0.75 lb (0.34 kg)

**Agency Approvals all models:**

**UL:** UL 873 (US) and CSA C22.2 No. 24 (Canada), File E27734 with CCN XAPX (US) and XAPX7 (Canada)

**Industry Canada:** ICES-003 (Canada)

**C-Tick:** EN55022:2006, IEC 61326-1:2005

**Agency Approvals all models**

**FCC:** Compliant to CFR 47, Part 15, Subpart B, Class A (US)

**CE:** EMC Directive 89/336/EEC (Europe Union)

**Agency Approvals wireless models**

**FCC:** Compliant to: Part 15, Subpart C This device complies with part 15 of the FCC rules. Operation is subject to the following two conditions:(1) this device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

**Agency Approval BACnet models**

**IMPORTANT**

All TB7200 series controls are for use as operating controls only and are not safety devices. These instruments have undergone rigorous tests and verifications prior to shipment to ensure proper and reliable operation in the field. Whenever a control failure could lead to personal injury and/or loss of property, it becomes the responsibility of the user/installer/electrical system designer to incorporate safety devices (such as relays, flow switch, thermal protections, etc.) and/or alarm system to protect the entire system against such catastrophic failures. Tampering of the devices or miss application of the device will void warranty.

By using this Honeywell literature, you agree that Honeywell will have no liability for any damages arising out of your use or modification to, the literature. You will defend and indemnify Honeywell, its affiliates and subsidiaries, from and against any liability, cost, or damages, including attorneys' fees, arising out of, or resulting from, any modification to the literature by you.

**Automation and Control Solutions**

Honeywell International Inc.  
1985 Douglas Drive North  
Golden Valley, MN 55422  
[customer.honeywell.com](http://customer.honeywell.com)

® U.S. Registered Trademark  
© 2014 Honeywell International Inc.  
63-2708—04 M.S. Rev. 12-14  
Printed in United States

**Honeywell**